




## TEST CERTIFICATE

### DERIVED TRANSMISSION LOSS DATA FOR PVC TWIN WALL PANELLING

SUPPLIED BY: SVP Industries  
TESTED BY: VIPAC ENGINEERS & SCIENTISTS LTD  
TEST DATE: 30/9/98  
UNIT: PVC Twin Wall Panelling, Double Layer

Third Octave Band Centre Frequency (Hz)	Sound Transmission Loss (dB)
125	14.7
160	17.2
200	20.0
250	27.5
315	29.8
400	31.2
500	34.1
630	36.8
800	40.1
1000	37.6
1250	39.5
1600	38.8
2000	39.9
2500	40.5
3150	48.7
4000	53.5

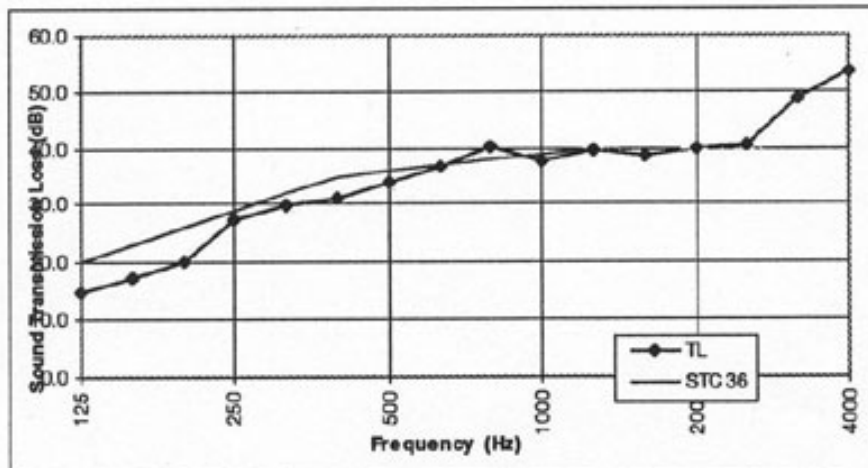

Determined Panel Performance: STC 36

Greg Theodoridis  
PROJECT ENGINEER

Norm Broner  
N.A.T.A. SIGNATORY

This laboratory is registered by the National Association of Testing Authorities, Australia. The tests reported herein have been performed in accordance with its terms of registration. This document shall not be reproduced except in full.