


# TEST CERTIFICATE

DERIVED TRANSMISSION LOSS DATA FOR PVC TWIN WALL PANELLING

SUPPLIED BY: SVP Industries  
TESTED BY: VIPAC ENGINEERS & SCIENTISTS LTD  
TEST DATE: 11/6/98  
UNIT: PVC Twin Wall Panelling

Third Octave Band Centre Frequency (Hz)	Sound Transmission Loss (dB)
125	12.9
160	12.8
200	14.4
250	17.4
315	17.5
400	16.8
500	19.4
630	17.9
800	19.9
1000	20.6
1250	21.6
1600	19.9
2000	20.1
2500	21.2
3150	24.0
4000	26.1

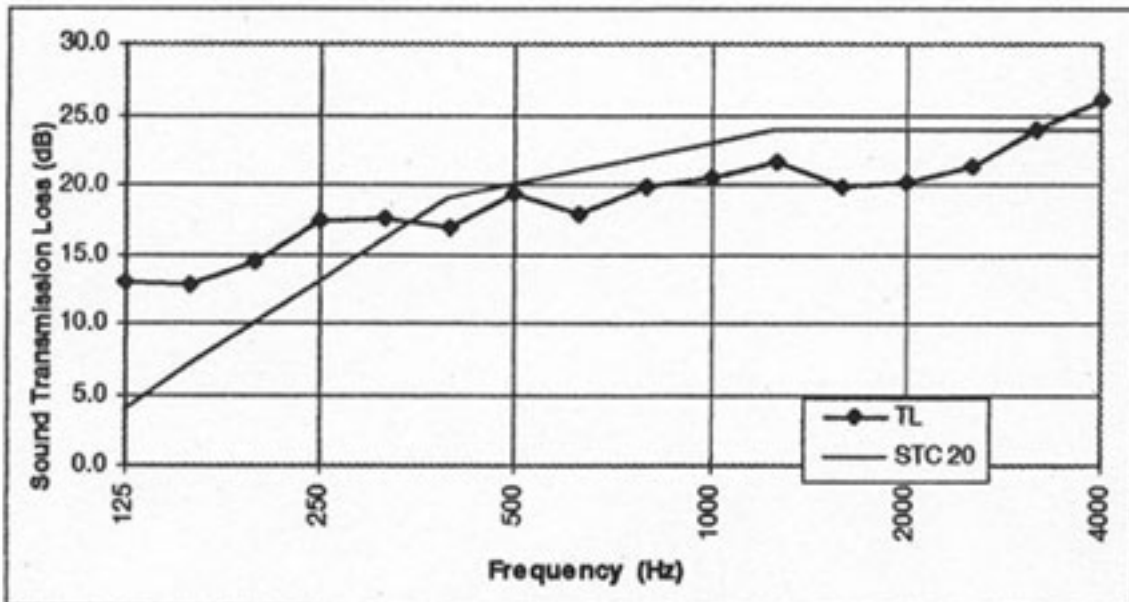

Determined Panel Performance: STC 20

Greg Theodoridis  
PROJECT ENGINEER

Norm Broner  
N.A.T.A. SIGNATORY